


ISOLATION REQUIREMENTS FOR A CONVENTIONAL SEWAGE SYSTEM

Dickinson - Iron District Health Department

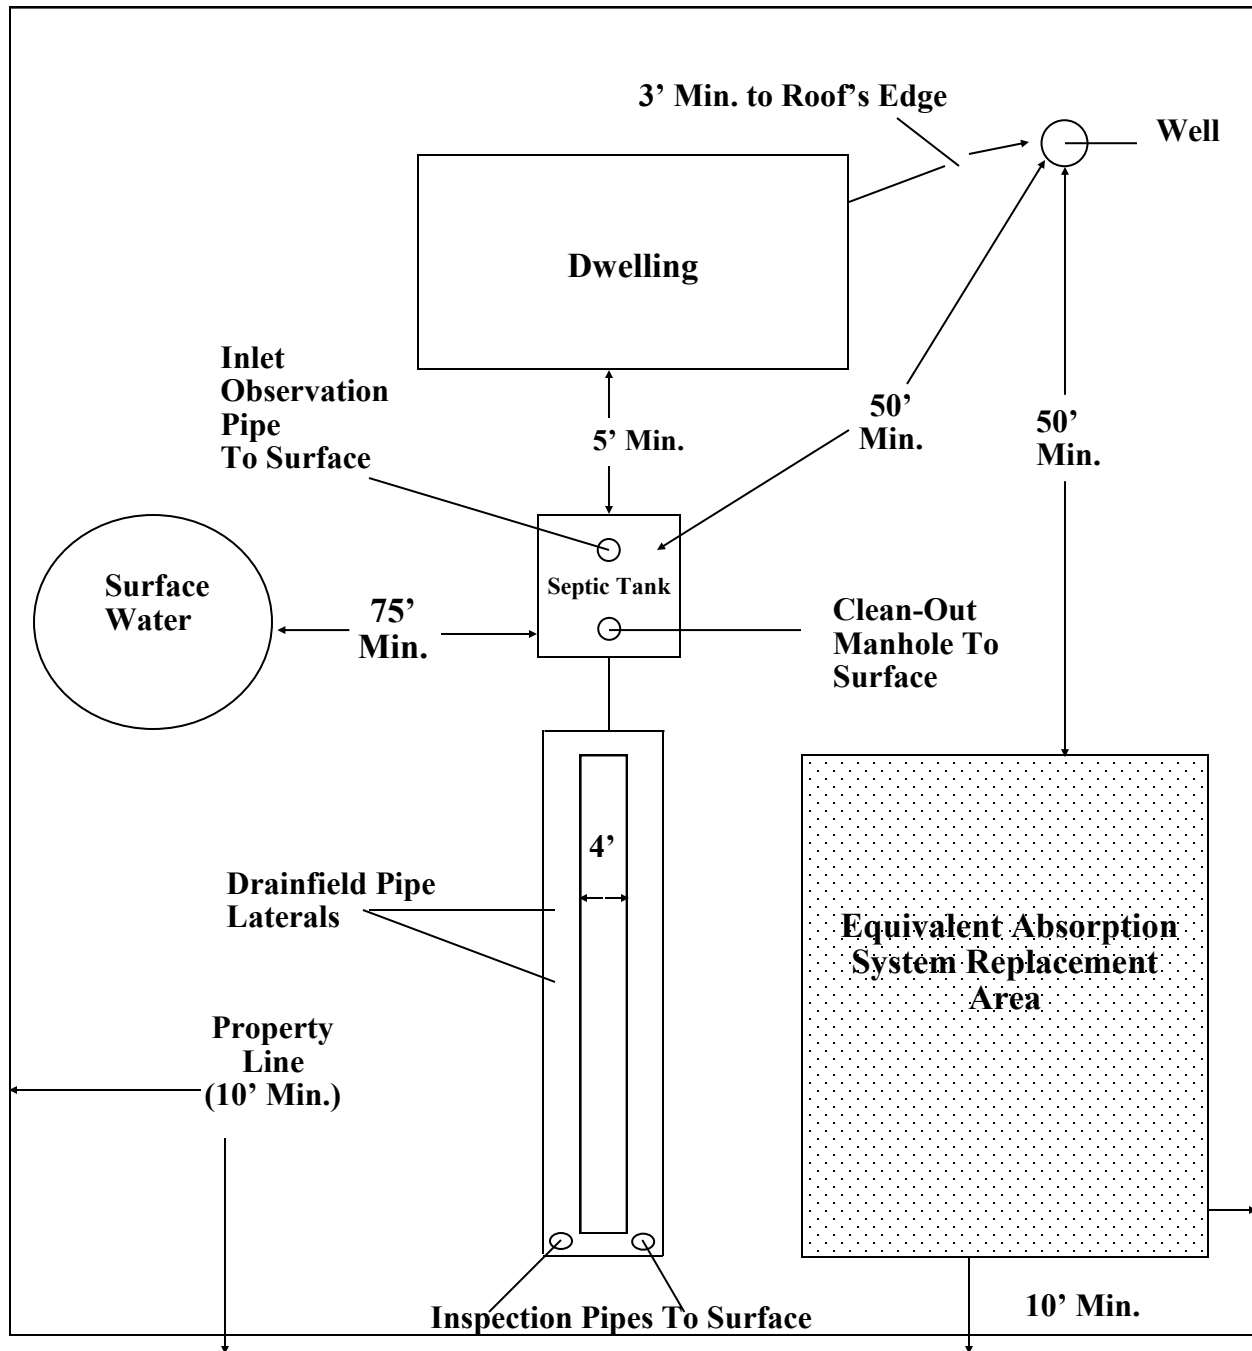

When feasible, an elongated absorption system is preferred.

Septic tank shall be located a minimum of ten feet (10') from any water line or steep embankment.

The absorption system shall be located a minimum of ten feet (10') from any waterline and twenty feet (20') from a steep embankment.

Maximum slope of drain tile lateral - Four inches (4") in one hundred feet (100') of pipe.

Chambers shall be installed as close to a level grade as possible.